



# 1. Industry 4.0, some aspects

<http://www.gipsa-lab.grenoble-inp.fr/~jean-marc.thiriet/asean/asean.html>



**Asean-Factori 4.0 project**

**Grenoble, 9<sup>th</sup> May,  
20<sup>th</sup> May 2022**

[jean-marc.thiriet@univ-grenoble-alpes.fr](mailto:jean-marc.thiriet@univ-grenoble-alpes.fr)

*UGA Grenoble – May 2022*

*Asean-Factori 4.0*

# Condensed CV

jean-marc.thiriet@univ-grenoble-alpes.fr



Docteur (Ph.D.) Université Henri Poincaré Nancy 1: February 1993

\* Associate Pr. Université Henri Poincaré **Nancy** 1 1993-2005

\* Habilitation à Diriger des Recherches UHP-Nancy 1: December 2004

**DEPENDABILITY OF INTELLIGENT DISTRIBUTED CONTROL SYSTEMS**

\* Full Professor Univ. Grenoble Alpes since 2005

Head of the GIPSA-Lab Research Lab (April 2011-December 2015)

Research in the **dependability of automation systems** which integrates communication networks (**Networked Control Systems**) and **cyber-security of cyber-physical systems** (smart grids, drones)

Teaching in **networks, network security**, signal processing, **automatic control**

Education projects

- Asean-Factori 4.0

- SALEIE: Strategic ALignment of Electrical and Information Engineering in European Higher Education Institutions


# At the heart of Europe

**Grenoble**  
3h by train from Paris  
1h40 by car from Geneva


**Dynamic environment**  
Population: 680,000  
60,000 students,  
15% of which foreigners



# Some Fields of research in Grenoble (70 Research Centres)



Smart systems  
Nano-techno  
Energy  
Water  
Environment  
Transportation

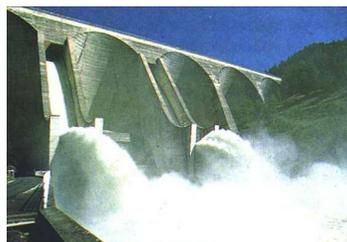

*Asean-Factori 4.0*

## 5 International laboratories and instruments

- ESRF, ILL, EMBL, GHMFL, IRAM

## 8 National research organizations


- CNRS, CEA, Inria, Inserm, INRAE, CRSSA, IRD, CHU Grenoble Alpes

## Major companies

- Sun Microsystems, HP, Orange, STMicroelectronics, Schneider Electric, Alstom, Xerox, Thales...



4 - JMT

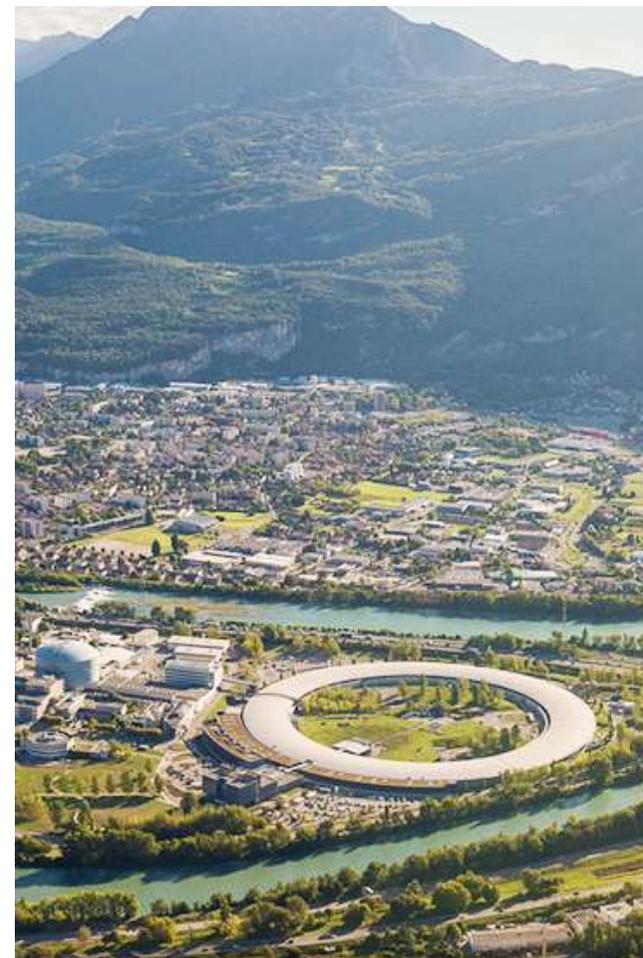

*UGA Grenoble – May 2022*

# UGA facts and figures

- ▶ **60,000** students
- ▶ **3,400** PhD students  
(45% international)
- ▶ **7,500** employees, of which
  - **5,500** academic
  - **2,000** staff
- ▶ **€ 512m** budget per year
  - ▶ **82** laboratories
  - ▶ **100+** research centers
  - ▶ **1** teaching hospital
- ▶ **175** hectares of campus



## From Industry 1.0 to Industry 4.0...

**Industry 1.0** : mechanization, **mechanical energy** (water, steam), ex: **agriculture** , **XIX<sup>th</sup> century**

**Industry 2.0** : mass production, **electricity**, ex: **car factory**  
~from 1920s to 1970s

**Industry 3.0** : automation (robots) => First **PLCs**  
(Programmable Logic Controllers)  
**computer**, ex: **pharmacy, food**, 1980

**Industry 4.0** : Cyber-physical systems, **communication**  
(**virtual tools: Cloud**), ex: **smart cities**, Nowadays




# From Industry 1.0 to Industry 4.0...

Purposes: Production, minimal cost

- **Production** strategy => to product
- **Maintenance** strategy => to take care of the production tools
- Logistics and **organization** strategy => to organize production, **transport** and maintenance in the best way

# Industry 4.0: some challenges

PARCE QUE CERTAINS SYSTÈMES SONT CRITIQUES  
NOS SERVICES DATACENTER AFFICHENT 100% DE DISPONIBILITÉ DEPUIS 10 ANS

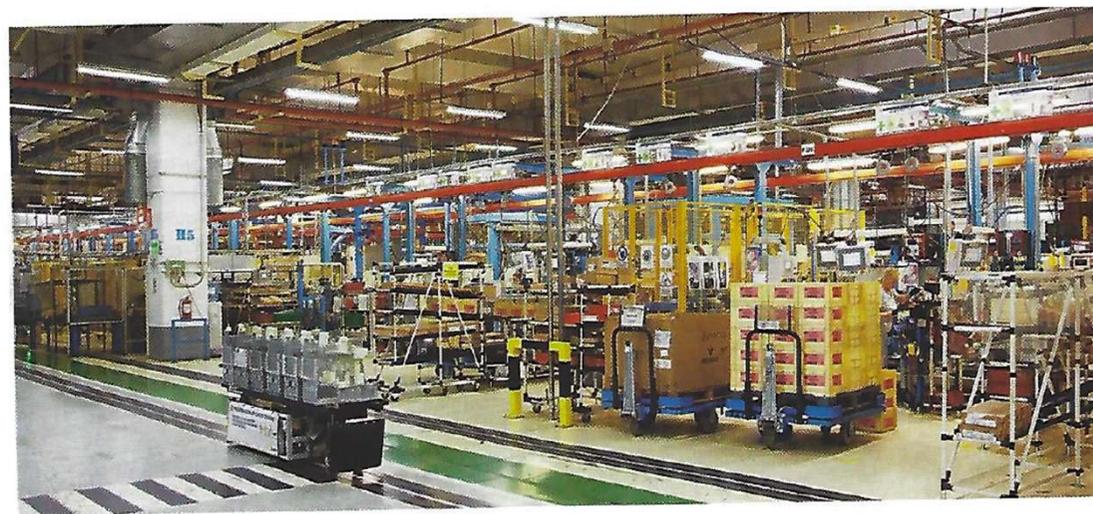

*L'usine du futur devrait faire la part belle à la 5G plutôt qu'aux réseaux LPWAN.  
Ces derniers pourront servir cependant à l'optimisation des bâtiments.*



Certification ISO 27001 pour les services Datacenter, Cloud, hébergement, supervision NOC/SOC, administration, innovation, commercialisation



Certification Hébergeur de données de santé sur les 6 périmètres

## Certification

« New » networks: 5G


Certification

Standards...

State of the Art  
Best practises  
In security

Quality  
Assurance  
processes


Asean-Factori 4.0

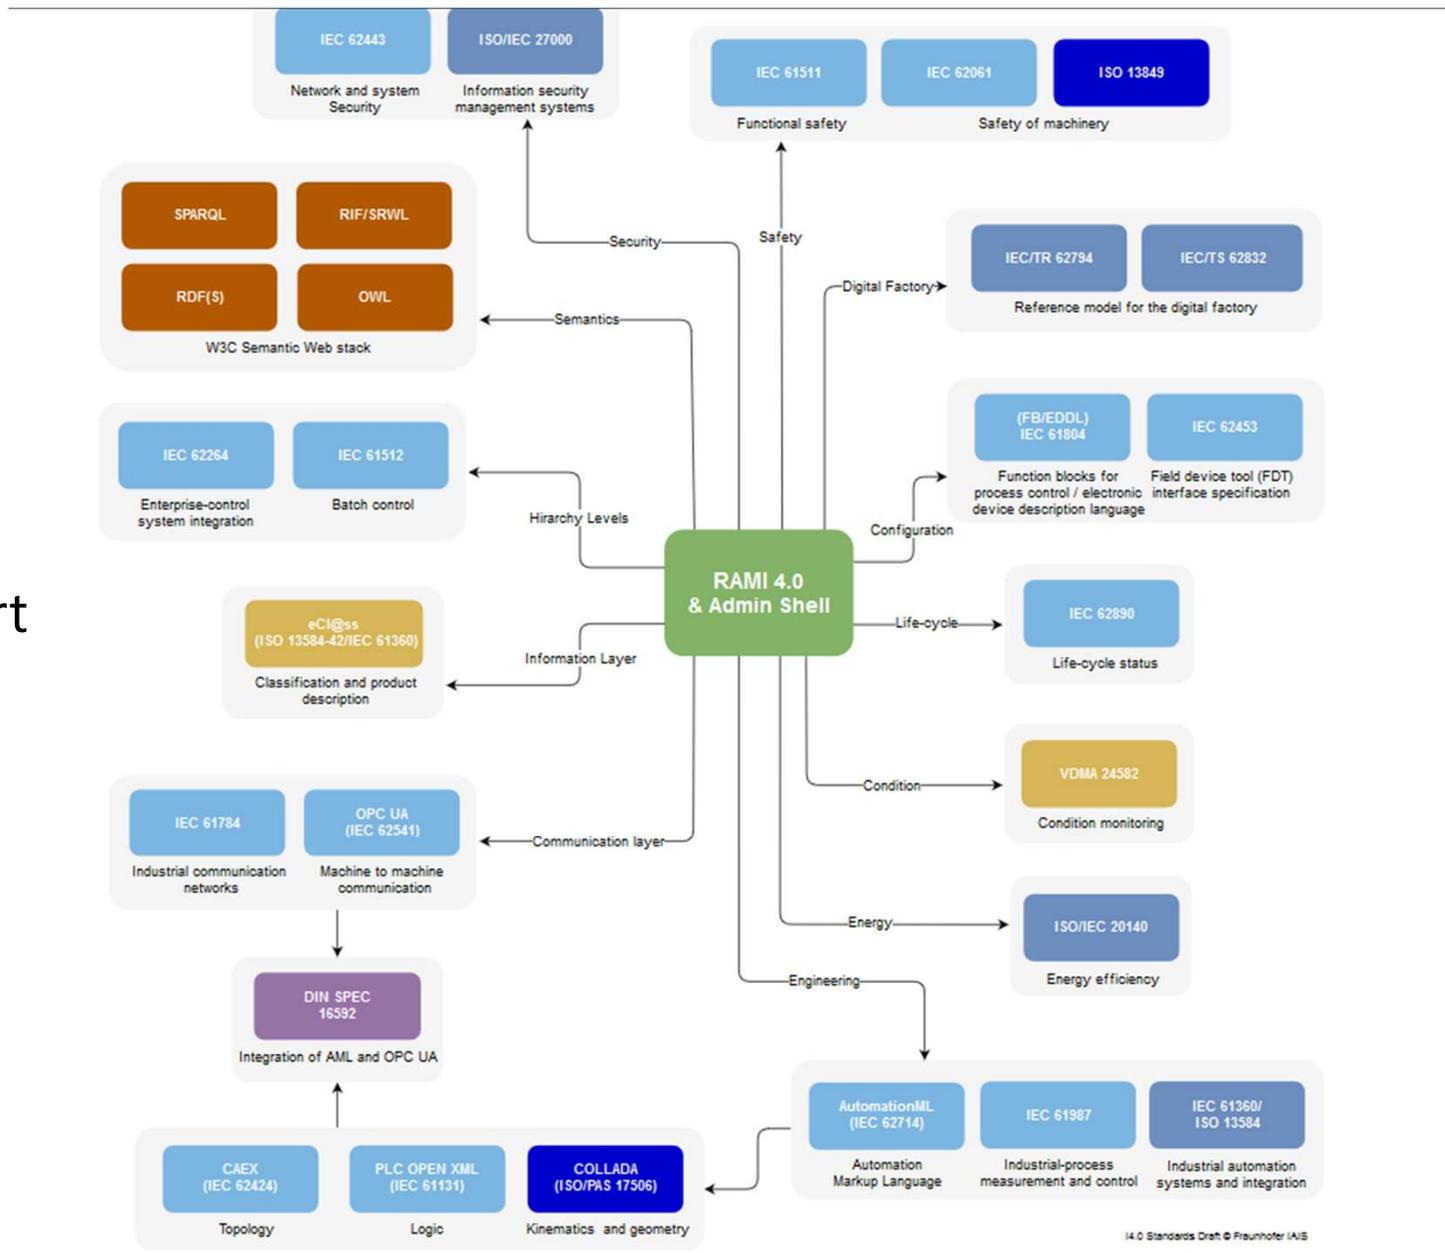

RAMI 4.0 Standards Draft © Fraunhofer IPA/IS


– May 2022

# PLC (Programmable Logic Controller)

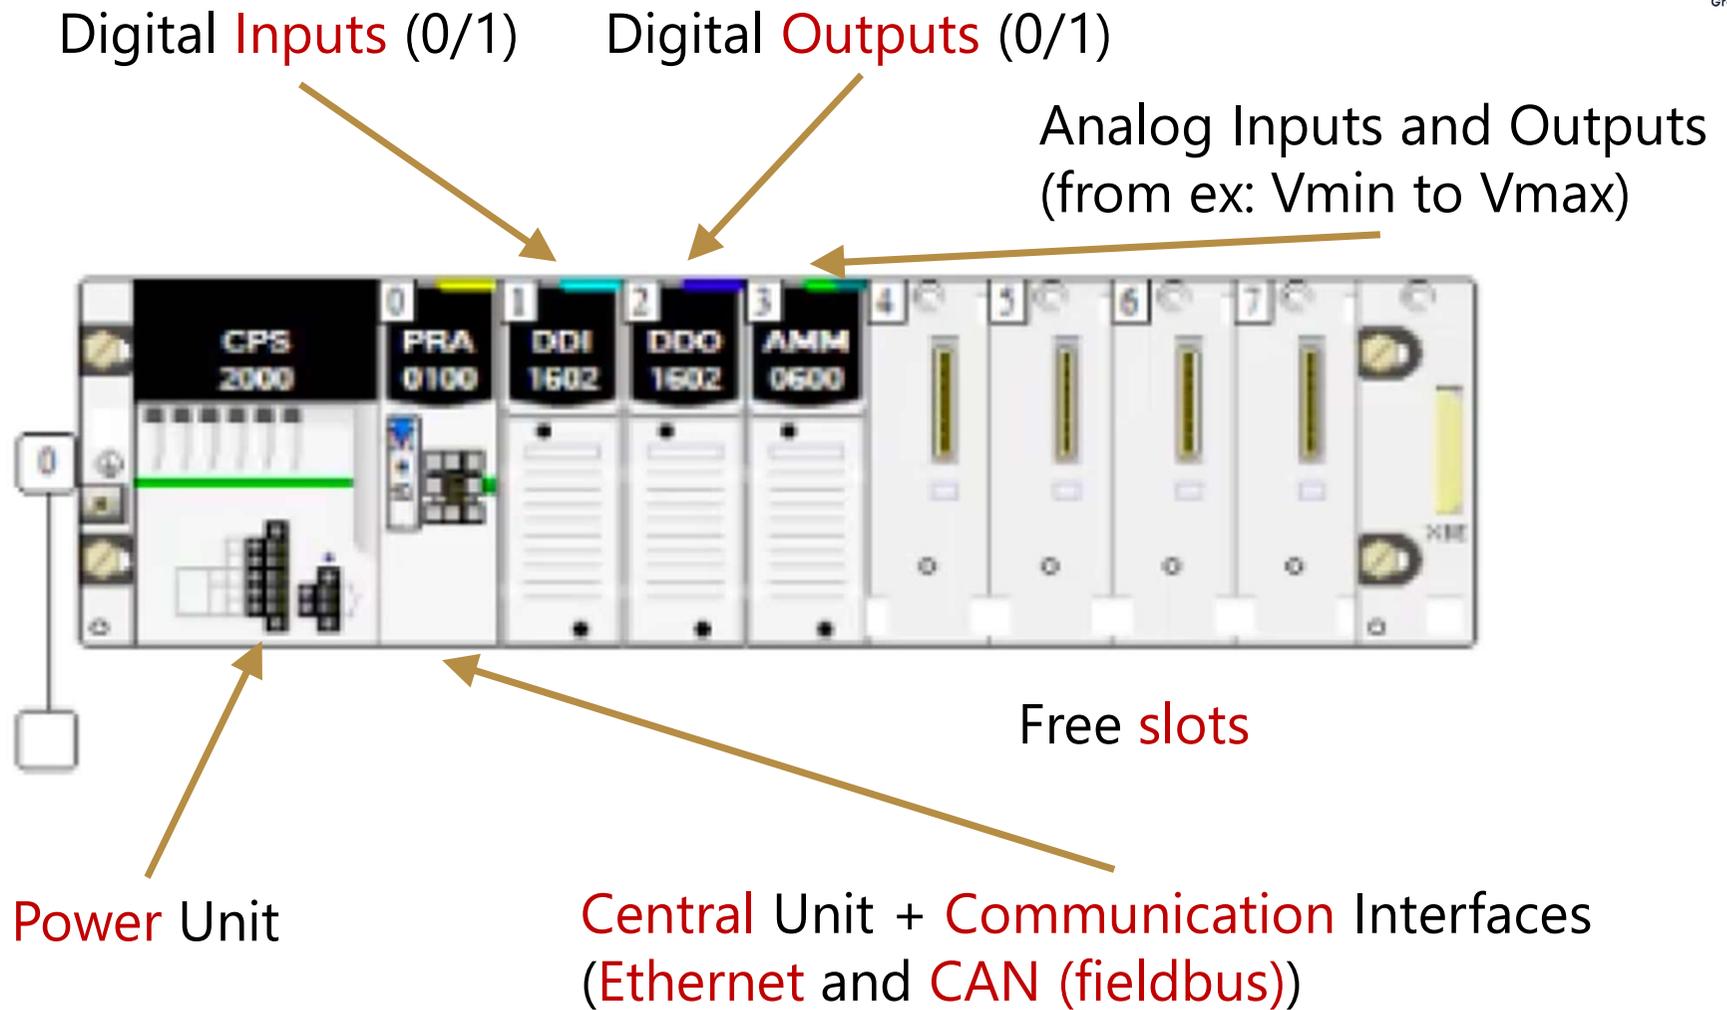

Digital Inputs and Outputs

Analog Inputs and Outputs

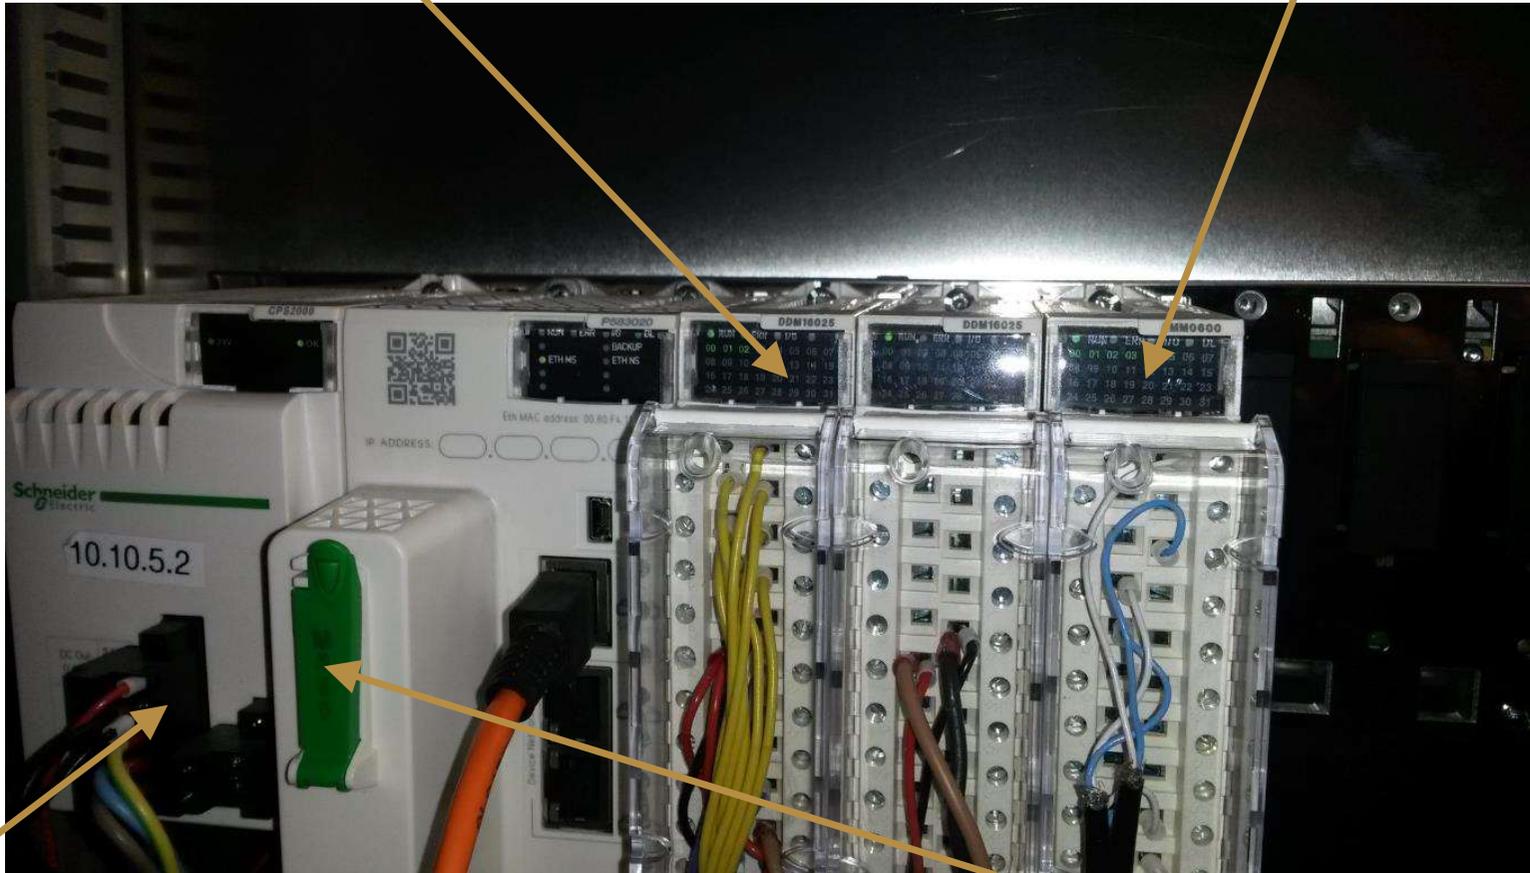

Power Unit

Central Unit + Communication Interfaces  
(Ethernet and CAN (fieldbus))



# The first PLC, model 084, was invented by Dick Morley in 1969



## The “084” - Details

The “084” consisted of three major components mounted on two vertical rails, one of which was hinged to allow for service access to the front and back.

## Ladder Logic:

The use of **Ladder Logic** was significant in the rapid acceptance of the “084” because the very same engineers and electricians who designed and maintained Factory Automation Systems could also program an “084”. Ladder Logic was simply an electronic version of the elementary electrical diagram that they already used -- not the case for other types of control systems being designed at the time.




# PLC Languages: IEC 61131


## Instruction List (IL)

```
A: LD  %IX1 (* PUSH BUTTON *)
   ANDN %MX5 (* NOT INHIBITED *)
   ST  %QX2 (* FAN ON *)
```

## Ladder Diagram (LD)

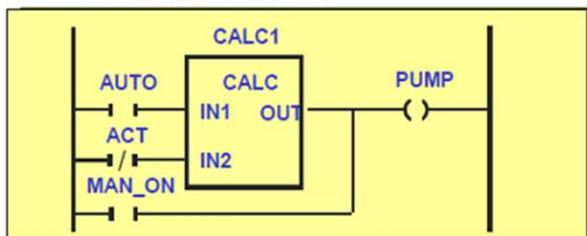

## Function Block Diagram (FBD)

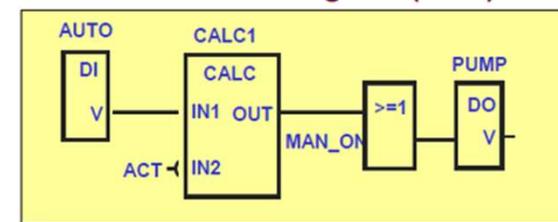


## Structured Text (ST)

```
VAR CONSTANT X : REAL := 53.8 ;
Z : REAL; END_VAR
VAR aFB, bFB : FB_type; END_VAR

bFB(A:=1, B:='OK');
Z := X - INT_TO_REAL (bFB.OUT1);
IF Z>57.0 THEN aFB(A:=0, B:="ERR");
ELSE aFB(A:=1, B:="Z is OK");
END_IF
```

## Sequential Flow Chart (SFC)

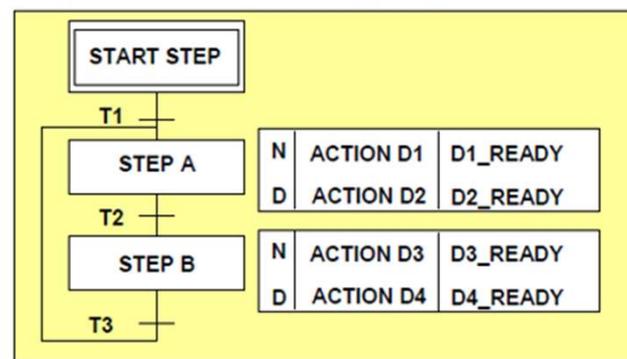

# An example

## SCADA: Supervisory Control And Data Acquisition


HMI:  
Human-  
Machine  
Interface



Local  
supervision



TCP/IP network



Remote  
supervision

2 important aspects:

**Control**  
**Safety**

Control  
Ex : trajectory

Local  
control



Fielbus Network




Safety PLC



Sensors/actuators (Input/Output)

Internet  
TCP/IP

# CIM Pyramid

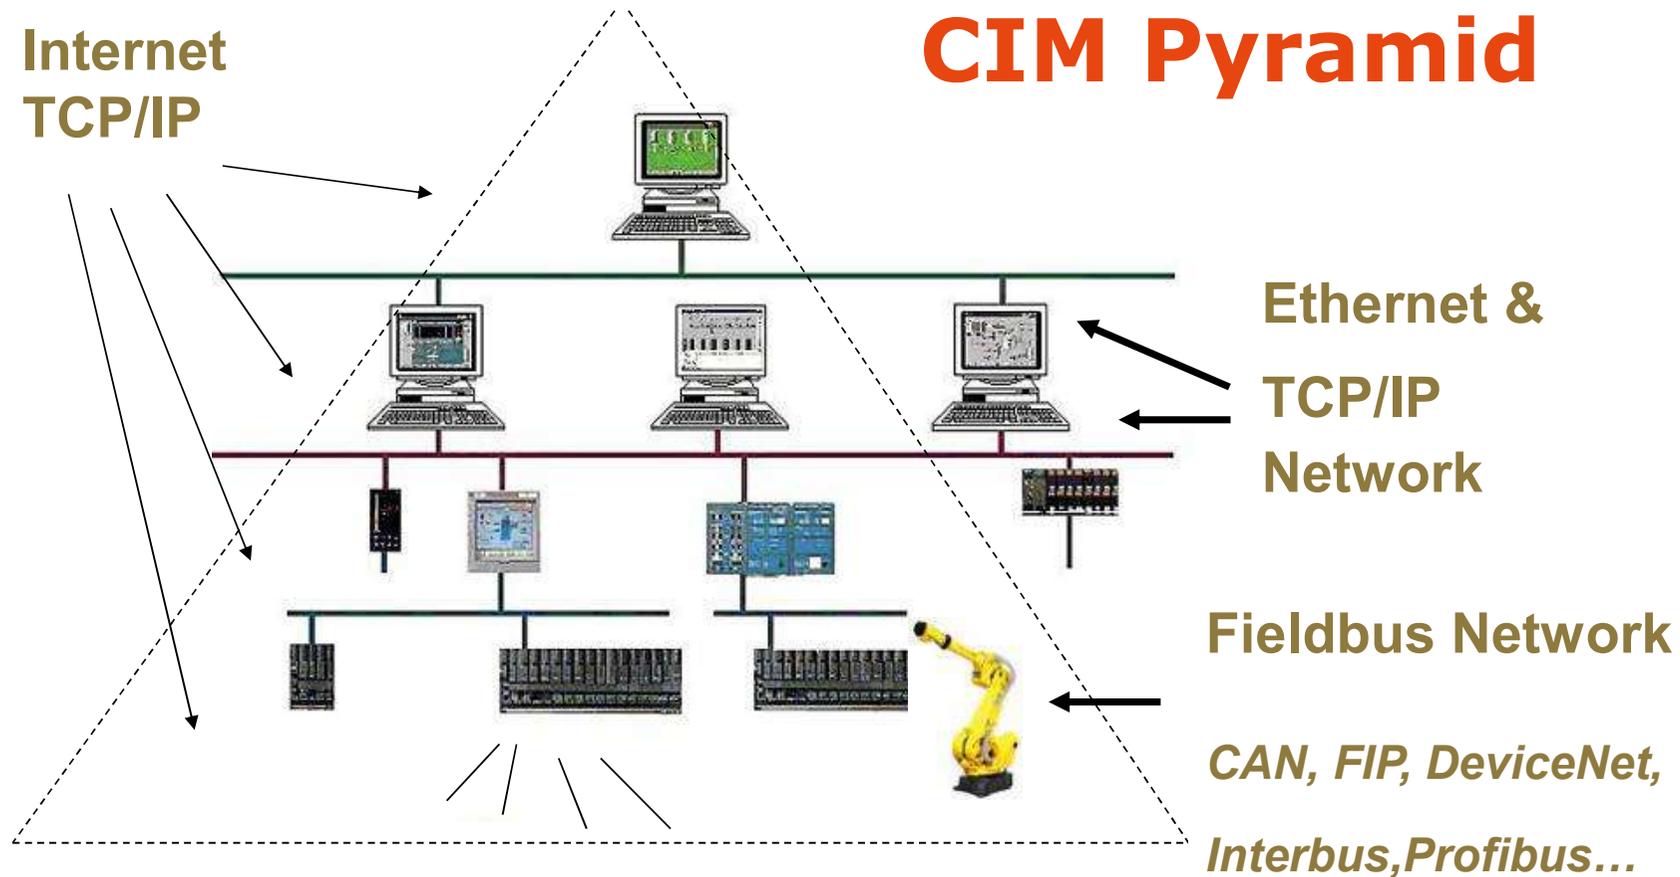

## ***Computer-integrated manufacturing (CIM)***

Describe the complete automation of manufacturing processes

Several network layers

# Example of a SCADA

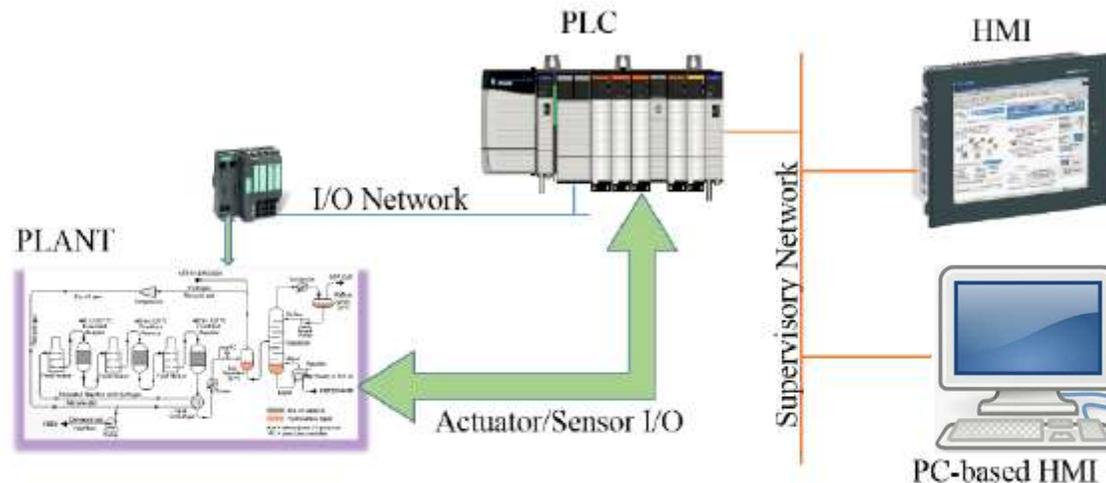



Figure 1. The simple SCADA system

*Supervisory Control And Data Acquisition*

**Supervision** : computerized monitoring and control of automated manufacturing processes


- Data acquisition
- Manual or automatic modification of process control parameters
- Use of PLCs, special machines, robots...

# Supervision

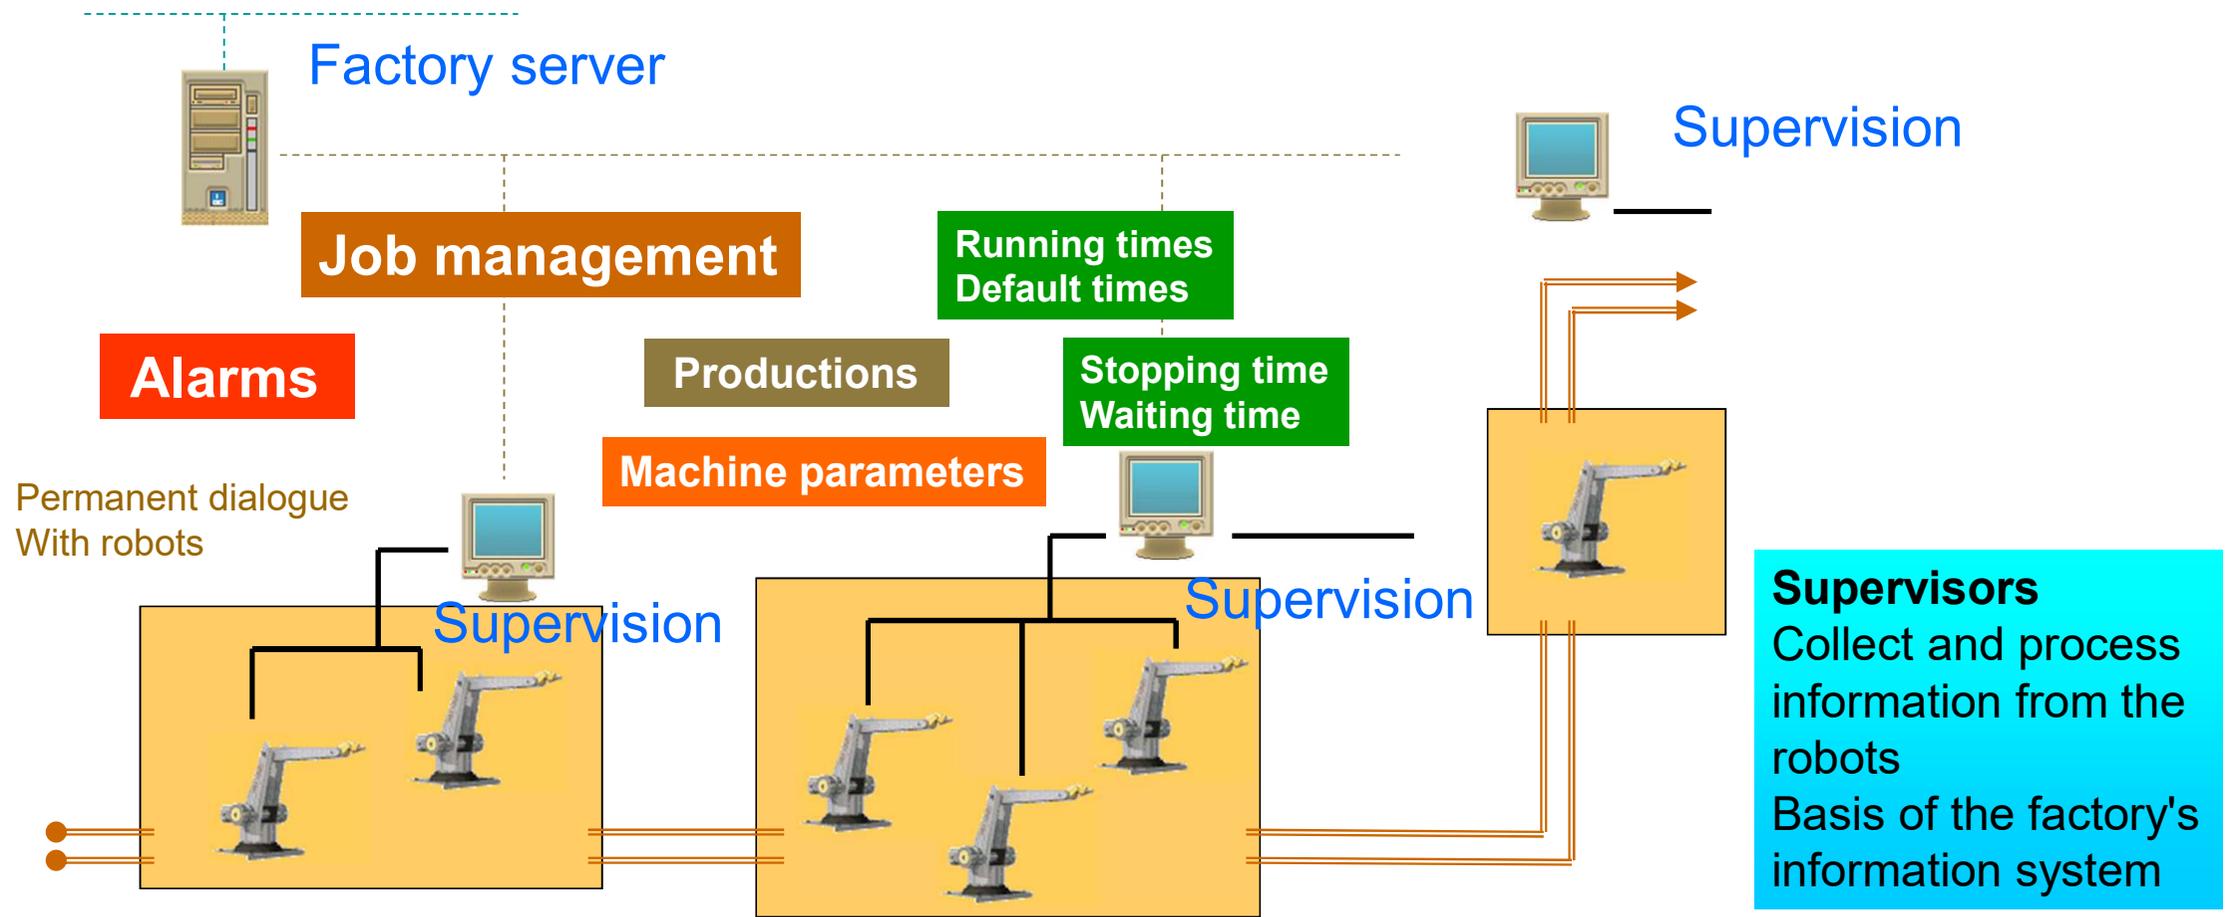

# Supervision functions


Synoptic: essential function of the supervision, provides a synthetic, dynamic and instantaneous representation of all the means of production of the unit

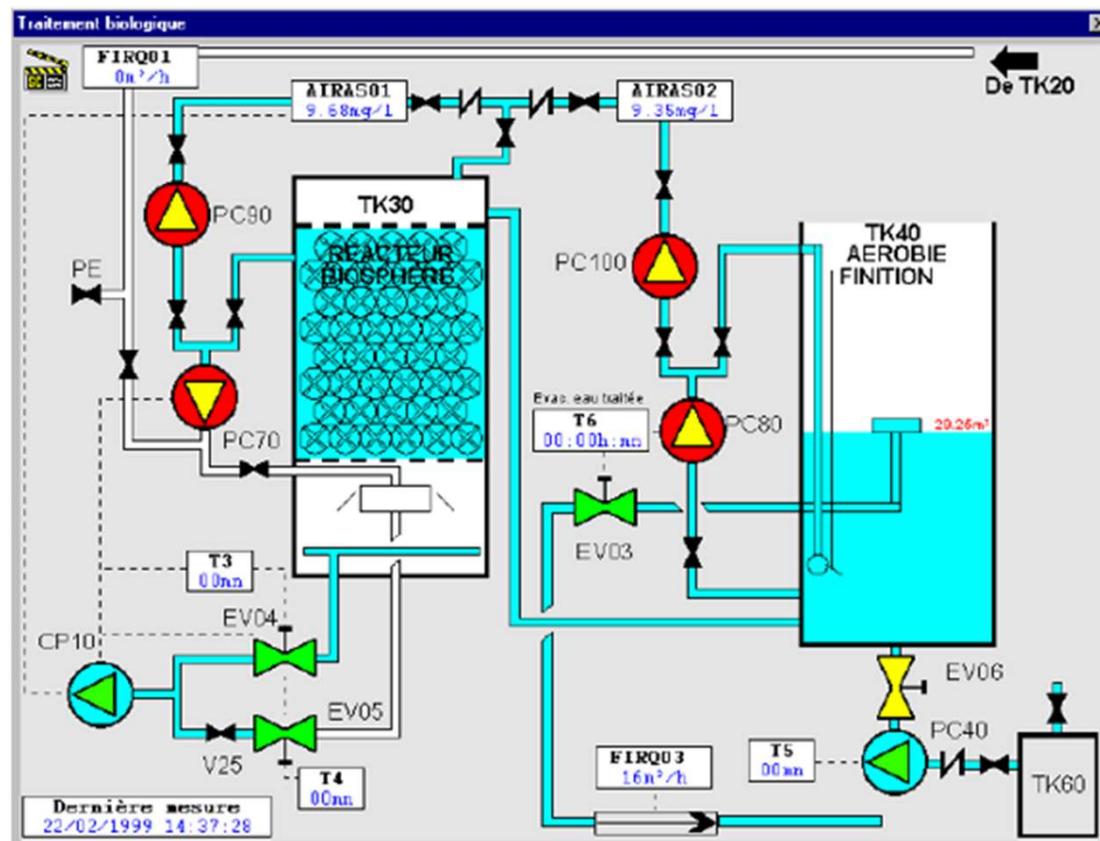

# Supervision functions

## Curves:

- gives a graphical representation of different process data
- gives the tools to analyze the historical variables

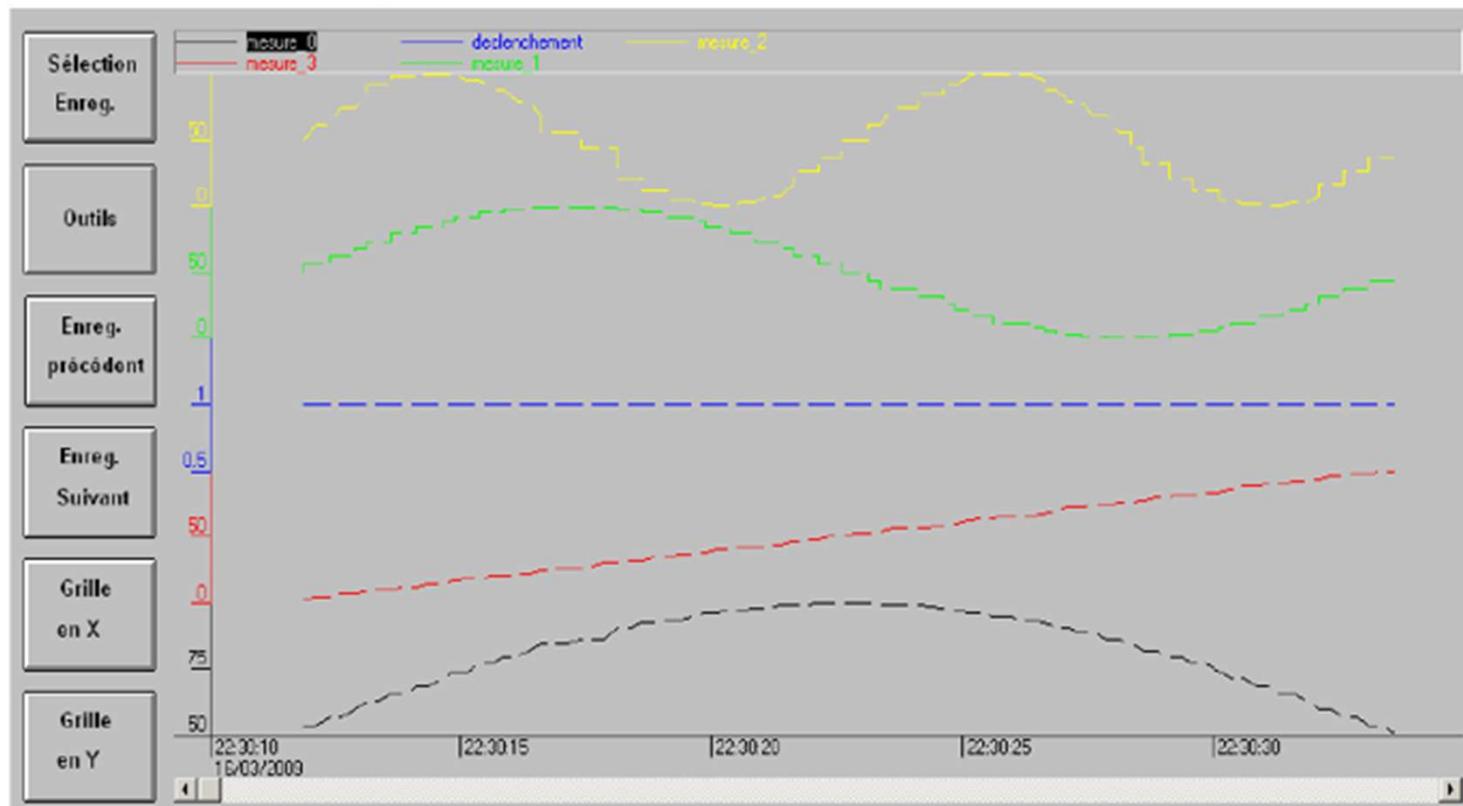

# Supervision functions


## Alarms

- Calculates in real time the conditions for triggering alarms
- Displays all alarms according to priority rules
- gives management tools
- ensures the recording of all the steps of the alarm processing

The screenshot displays a software interface for alarm supervision. At the top, there is a section titled "Consignation d'état" (Status Consignment) with two tables. The right table shows a single entry: "16/03/2009 22:30:52 Départ lot n° 1." Below this is a section titled "Consultation des historiques" (History Consultation) with a "(Filtre courant :)" (Current Filter) label. It contains a large table of alarm events with columns for Date, Heure, Événement, Libellé Alarme, Poste, and Opérateur. The table lists multiple fire detection events across different buildings and floors. At the bottom, there are two panels: "Filtres" (Filters) and "Acquittements" (Acknowledgments), each with buttons for "General", "Pompes", "Palettes", and "GTC- GTB".

Date	Heure	Événement	Libellé Alarme	Poste	Opérateur
16/03/2009	22:32:02	Disp. Acq	Batiment2 Détection incendie 2eme étage Sud		
16/03/2009	22:32:02	Alm Acq	Batiment1 Détection incendie Rez de chaussée Nord		
16/03/2009	22:32:01	Alm Acq	Batiment2 Détection incendie 2eme étage Sud		
16/03/2009	22:32:00	Disp. Acq	Batiment4 Détection incendie 1er étage Sud		
16/03/2009	22:31:59	Alm Acq	Batiment4 Détection incendie 1er étage Sud		
16/03/2009	22:31:57	Disp. Acq	Batiment2 Détection incendie 1er étage Sud		
16/03/2009	22:31:57	Alarme	Batiment1 Détection incendie Esc de chaussée Nord		
16/03/2009	22:31:53	Disp. NAcq	Batiment2 Détection incendie 1er étage Sud		
16/03/2009	22:31:52	Alarme	Batiment2 Détection incendie 2eme étage Sud		
16/03/2009	22:31:50	Disp. Acq	Batiment4 Détection incendie 1er étage Nord		
16/03/2009	22:31:48	Alarme	Batiment4 Détection incendie 1er étage Sud		
16/03/2009	22:31:48	Alm Acq	Batiment4 Détection incendie 1er étage Nord		
16/03/2009	22:31:44	Alarme	Batiment2 Détection incendie 1er étage Sud		
16/03/2009	22:31:42	Alarme	Batiment4 Détection incendie 1er étage Nord		

# Supervision functions

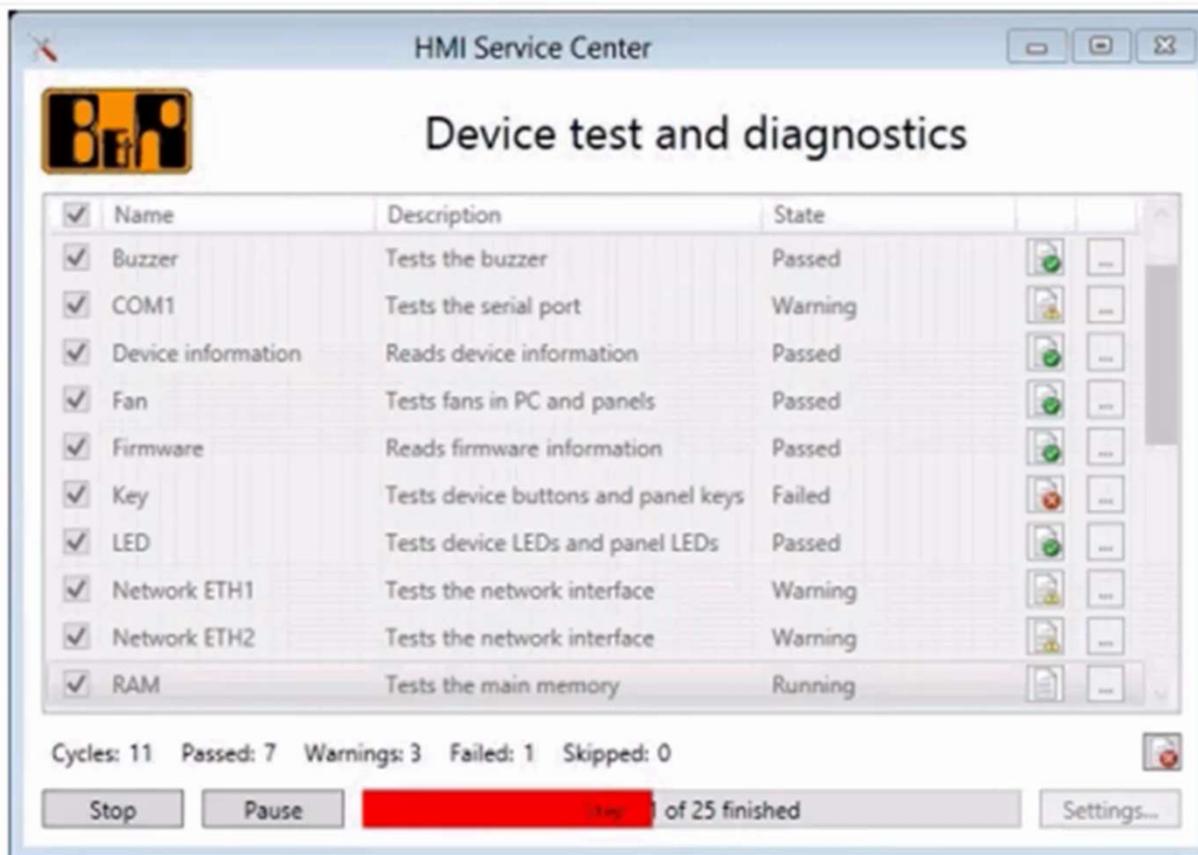

Circumscribe the **cause** of the feared event (cause of the incident)

Limit the **impact** of the event, protect (consequences)

Be able to **assess** the system **after the incident**: repair, reconfigure (total and partial redundancies)

**Reconstruct, recover** the system: time required for it to be operational again, what happens and what are the recovery steps? (Activity Return Plan)

Other related aspects: **robustness, resilience** (ability to maintain the system as well as possible in a situation of "attacks")


# Alarms detection

- TP (true positive) corresponds to correctly identified alarms
- FP (false positive) corresponds to authentic behavior identified as faulty
- TN (True Negative) corresponds to the correct rejection of authentic behavior
- FN (False Negative) corresponds to undetected failures
- Two metrics are used to evaluate the performance of alarm detection
  - True Positive Rate  $TPR = TP / (TP + FN)$   
=> 1 if no False Negative
  - False Positive Rate  $FPR = FP / (FP + TN)$   
=> 0 if no False Positive

# Supervision functions

Historicization of the process:


- Allows the saving of time-stamped events (selective archiving)
- provides search tools in the archived years
- provides the possibility to run the synoptic again with archived data (replay function)
- allows to keep a validated trace of critical data (traceability of production data)

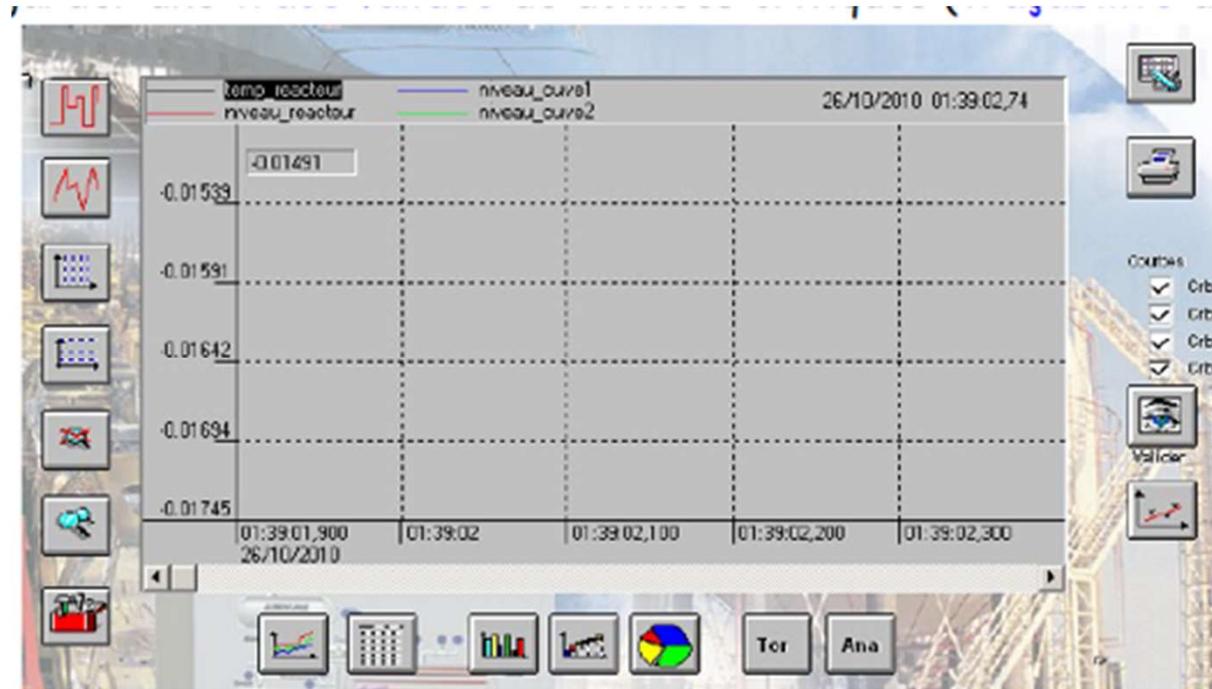

# Supervision functions

Management of production lines and recipes:

- Provides a tool for managing production batches
- Manages the parameters of the machines for each batch (recipes)

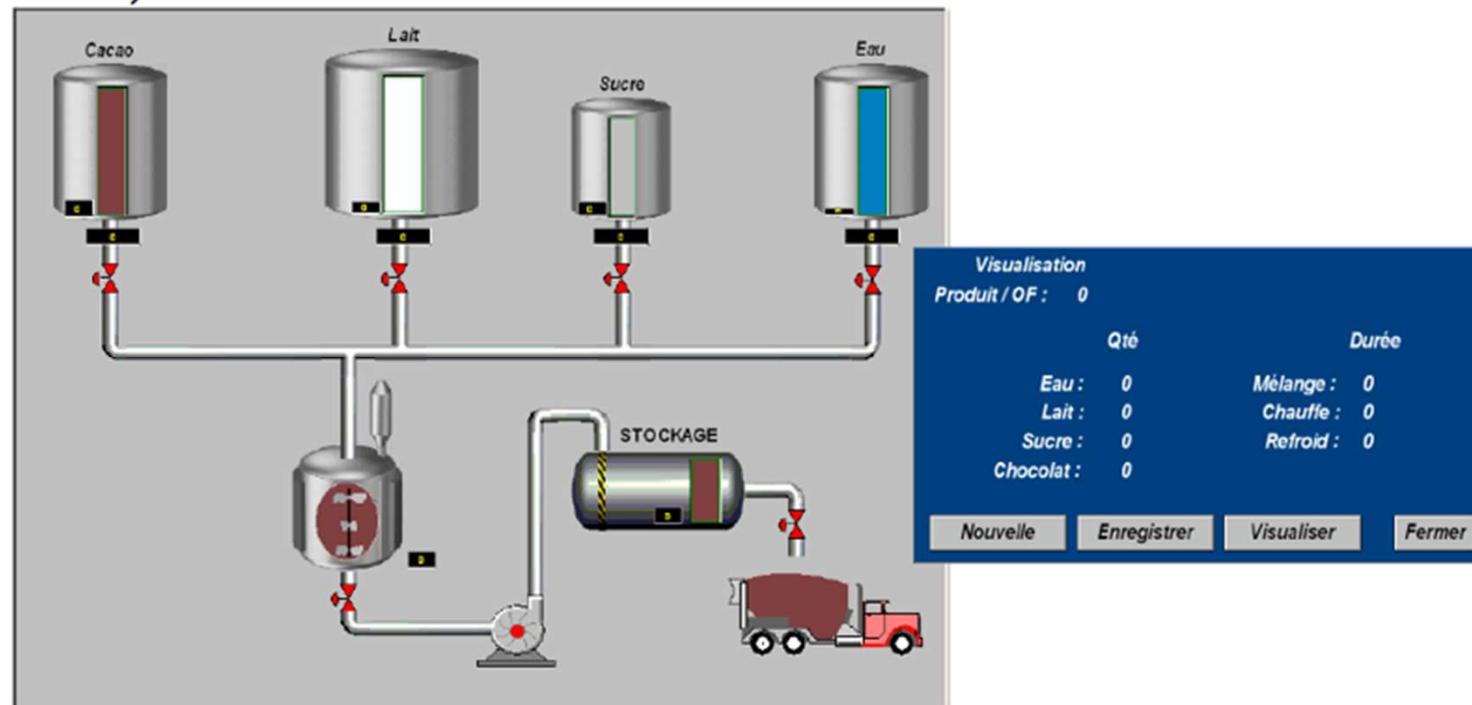

# Other aspects of Industry 4.0 (from Seminar spring 2021)

1. Description of the Main Industrial sector using PLC - Industry 4.0
2. Challenges: Safety & Cyber-security
3. **Maintenance**
4. **Logistics & Organisation**
5. **Production**
6. **Supervision**
7. **Robotics in Industry**
8. Conclusion
9. References



- Industry 4.0
  - Concept around **Information Systems** (from the « field » (sensors, actuators) to the higher levels of management in the companies)
  - Various functionalities: **Production**, but also **Maintenance, Logistics, Transport**
  - **Robotics** is an important aspect (for Production, Maintenance, Transport...)
- **PLC, Programmable Logic Controller**
  - « Industrial » computer
  - Inputs/outputs to be connected to **physical processes**
  - **Communication networks**
    - Fieldbus networks, « Industrial networks », for interactions between PLC (ex: Master/slave), I/O interactions with PLC
    - Classical networks for supervision
    - More and more in the Cloud (virtual devices) => **Cyber-security challenges**
- « Integration » IT (Information Technology)/ICS (Industrial Control Systems)
- Challenges in **Dependability/Safety and in « Cyber-Security »** => Convergence between these concepts
  - Risk Analysis, risk management

# Some references

- J.F. Aubry, Nicolae Brnzei – Systems Dependability Assessment, Modeling with Graphs and Finite State Automata, Wiley, Fév. 2015.
- J.C. Laprie & al. – Guide de la sûreté de fonctionnement – Cépaduès, 1995.
- A. Villemeur – *Sûreté de fonctionnement des systèmes industriels* – Editions Eyrolles, Paris, 1988.
- C. Davis, M. Schiller, K. Wheeler - *IT Auditing: using control to protect assets* – 2007, Mc Graw Hill
- Cours Stéphane Mocanu, ENSE3, Industrial Communication Labs, 2016
- Cours Emmanuel Simeu, Polytech Grenoble, Supervision
- Patrick Monassier, cours CESI 2009, Informatique industrielle.
- Pierre Bonnet, cours Université de Lille, Introduction à la supervision, 2010
- EPFL, Industrial Automation course
- P\_RAYMOND\_BTS\_MAI\_Les\_API
- Transmissions et réseaux, S. Lohier & D. Présent, Dunod, Paris, 2003.
- Cours Stéphane Mocanu, ENSE3, Industrial Communication Labs, 2016
- Cours Emmanuel Simeu, Polytech Grenoble, Supervision
- Cours de Blaise Conrard, Polytech Lille.
- Patrick Monassier, cours CESI 2009, Informatique industrielle.
- Pierre Bonnet, cours Université de Lille, Introduction à la supervision, 2010
- G. Boujat et P. Annaya, Automatique industrielle en 20 fiches, Dunod, 2007
- W. Bolton, Automates programmables industriels, Dunod, 2015.
- Duc Tran Trung , Cybersecurity risk assessment for Unmanned Aircraft System, PhD, Univ. Grenoble Alpes, Feb. 2021

# Some references

<https://www.technologuepro.com/cours-automate-programmable-industriel/Les-automates-programmables-industriels-API.htm>

<http://www.est-usmba.ac.ma/coursenligne/GE-S2-M8.1-Automatismes%20logiques%20Industriels-CRS-EI%20Hammoumi.pdf>

[http://colasapoil.free.fr/HEI/HEI5%20TC/Maintenance/h5\\_tc\\_maintenance\\_coursv2\\_coursv2\\_1783.pdf](http://colasapoil.free.fr/HEI/HEI5%20TC/Maintenance/h5_tc_maintenance_coursv2_coursv2_1783.pdf)

<https://www.cours-gratuit.com/cours-divers/cours-sur-les-definitions-methodes-et-operations-de-la-maintenance>

<https://www.manager-go.com/logistique/organisation-de-la-logistique.htm>

<https://www.lecoindesentrepreneurs.fr/logistique-entreprise/>  
<https://d1n7iqsz6ob2ad.cloudfront.net/document/pdf/5346e085efe6e.pdf>

<https://www.icours.com/cours/economie/la-production>

[https://perso.imt-mines-albi.fr/~fontanil/THESE/5\\_Partie1\\_p13\\_43.pdf](https://perso.imt-mines-albi.fr/~fontanil/THESE/5_Partie1_p13_43.pdf)

jean-marc.thiriet@univ-grenoble-alpes.fr

Merci pour votre attention  
Merci pour votre attention



សូមអរគុណចំពោះការយកចិត្តទុកដាក់  
របស់អ្នក។ (KH)

ຂອບໃຈຫຼາຍໆ ສຳ ລັບຄວາມສົນໃຈຂອງ  
ທ່ານ (LAO)

ขอบคุณมากสำหรับความสนใจของคุณ  
(TH)

**Merci pour votre  
attention**

**Thank you for your  
attention**

